


INTEGRAL CURB AND SIDEWALK REPLACEMENT

NOTE: ALL LOCATIONS REQUIRING INTEGRAL CURB & GUTTER SHALL BE DETERMINED BY THE COMMISSIONER OF PUBLIC WORKS PRIOR TO ANY REPLACEMENT.

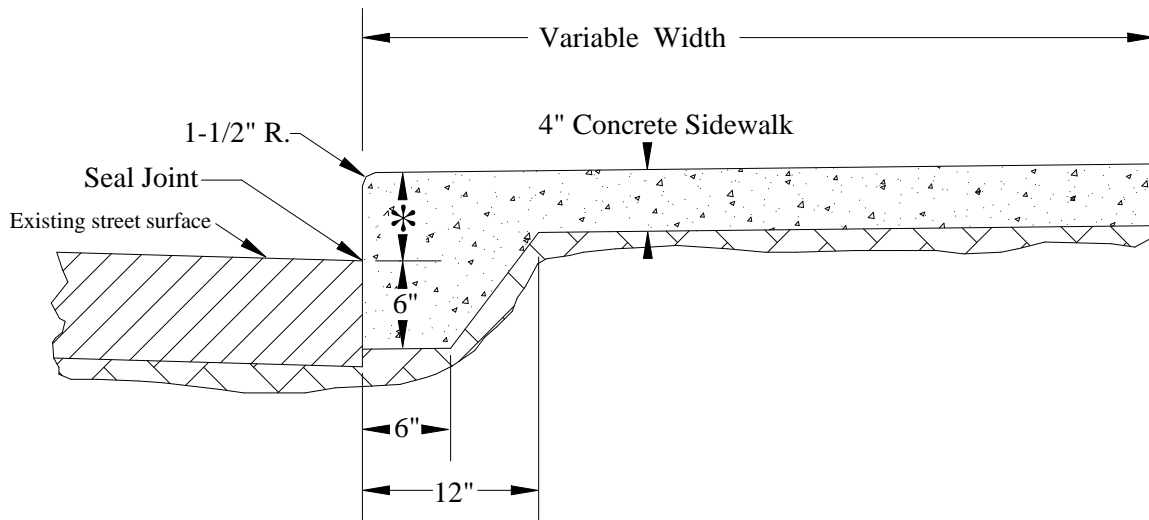

* Height to be determined by adjacent curb.

SIDEWALK REPLACEMENT ABUTTING BUILDINGS

Place 1/2" Premolded Expansion Filler where sidewalk abuts the building. Hold expansion joint 1/2" below top of sidewalk and fill with joint sealer.

